
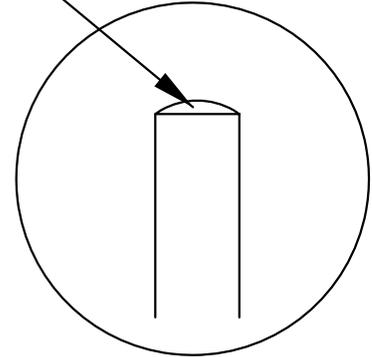


PAINT WITH HIGH GLOSS
ENAMEL - CHROME YELLOW

FILL CENTER OF TUBING WITH
CONCRETE; 1/2" CROWN AT
TOP

3" MIN X 2 1/2" X 6'
STEEL TUBING
(4" DIP MUST BE
USED IN ALL CASES
WHERE BOLLARD IS
PROTECTING FIRE
HYDRANT)

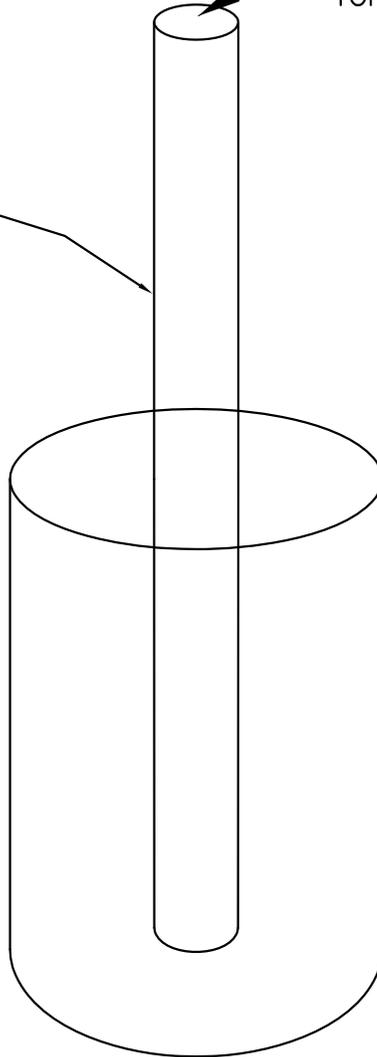

MINIMUM OF 12" ROUND
EXCAVATION

CONCRETE FILL AROUND TUBING
BURY 3'-0"

REVISIONS:

BOLLARD

SCALE:	N.T.S.
DATE:	July 2013
APPROVED BY:	D. Danicic
STANDARD DRAWING	104