


NOTES

1. STANDARD MANHOLE TO BE USED FOR PIPES 24" AND LESS.
2. PRECAST CONCRETE STRUCTURES SHALL HAVE STRENGTH OF 4000 PSI.
3. STANDARD MANHOLE DEPTH = 8' TOP OF FRAME TO INVERT.
4. LATERAL LINES TO MATCH TOP OF INLET PIPE AT MANHOLE.
5. ALL INTERIOR JOINTS AND CONNECTIONS SHALL BE WATER TIGHT, AND GROUTED WITH NON-SHRINK GROUT.
6. ALL MANHOLES SHALL BE VACUUM TESTED PRIOR TO ACCEPTANCE.
7. BOND ALL MANHOLE SECTION GROOVES WITH MASTIC SEAL.
8. IF END OF LINE MANHOLE, STEPS SHALL BE LOCATED ON DOWNSTREAM SIDE AND CHANNEL SHALL BE CONSTRUCTED FULL WIDTH OF INTERIOR.

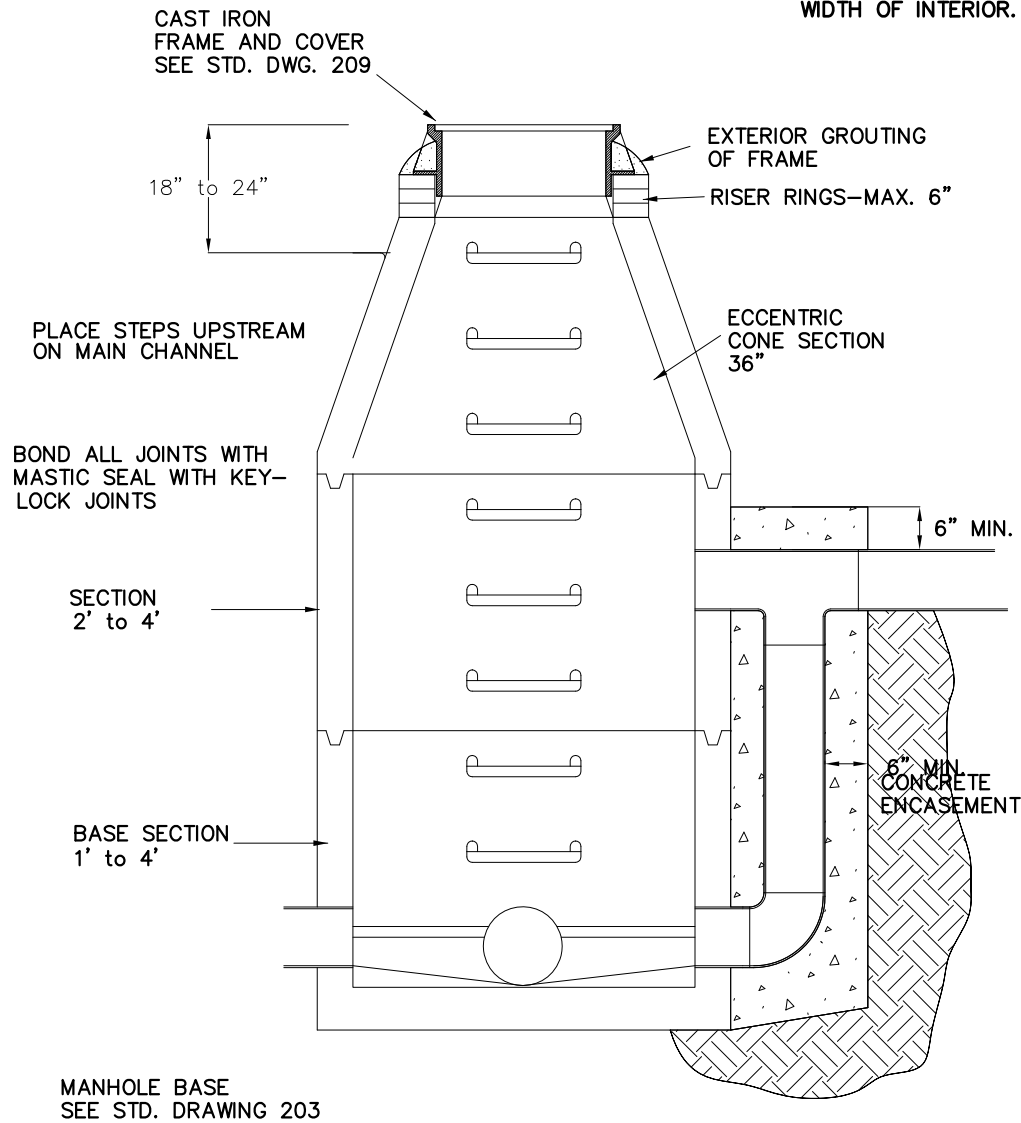

REVISIONS:

OUTSIDE
DROP MANHOLE

SCALE:	N.T.S
DATE:	May 2007
APPROVED BY:	D. Danicic
STANDARD DRAWING	207