



TRUNCATED DOME DETAIL

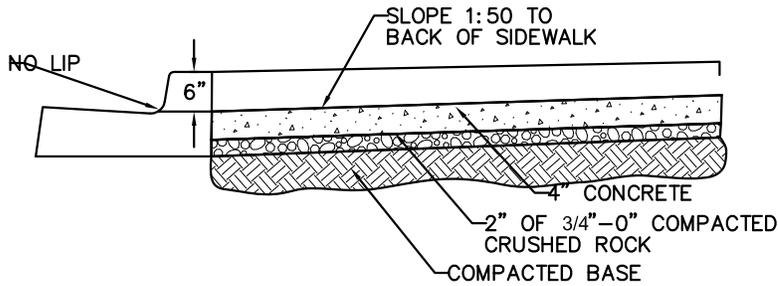

SECTION A-A

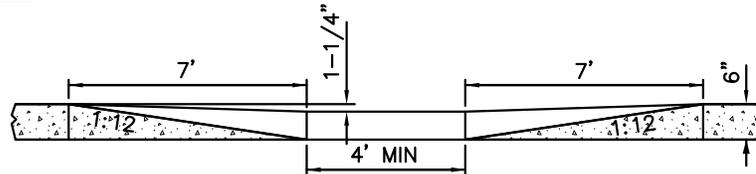

SECTION B-B

NOTES:

1. CONCRETE SHALL HAVE STRENGTH OF 3000 P.S.I. AT 28 DAYS.
2. SIDEWALK RAMPs ARE REQUIRED AT ALL NEW INTERSECTIONS.
3. REPLACEMENT CURBS MUST BE POURED AGAINST A VERTICAL EDGE OF EXISTING CURB.
4. CONCRETE IN A REPLACEMENT CURB SHALL NOT PROTRUDE PAST THE FACE OF THE CURB IN THE ASPHALT REPLACEMENT AREA.
5. HORIZONTAL AND VERTICAL ALIGNMENT SHALL BE WITHIN 1/8" IN 10'.
6. DETECTIBLE SURFACE SHALL BE CONSTRUCTED WITH PREFABRICATED UNITS. TEXTURE SHALL NOT BE WET IMPRINTED. TRUNCATED DOME PATTERN SHALL BE INLINE, ALIGNED IN THE DIRECTION OF THE RAMP.
7. DETECTIBLE SURFACE SHALL BE YELLOW (FEDERAL COLOR #33538).
8. THIS DETAIL IS APPROVED FOR USE IN THE PUBLIC RIGHT OF WAY ONLY.

City of
Newberg

PUBLIC WORKS ENGINEERING DIVISION
414 E. FIRST STREET NEWBERG, OR 97132
PHONE: 503-537-1240
FAX: 503-537-1277

REVISIONS:
04/08/2010

**SIDEWALK RAMP
TYPE "B" SIDEWALK**

SCALE:	N.T.S.
DATE:	May 2007
APPROVED BY:	D. Danicic
STANDARD DRAWING	507